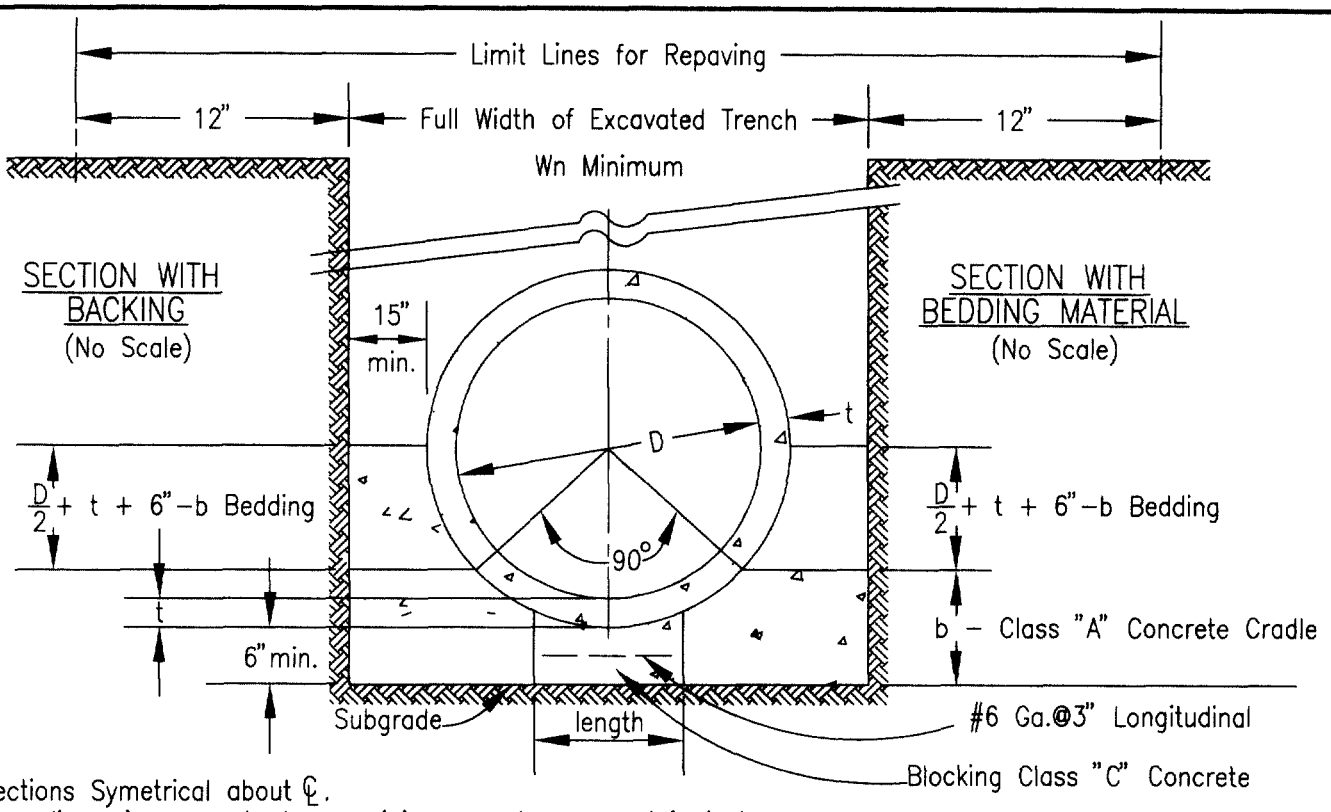

NOTES:

Sections Symetrical about ℄.
Pipe dimensions on chart are minimum and expressed in inches.
On sanitary sewer construction trench dams are required as specified under 901.11.
Blocking shall have the length shown in the chart or of sufficient length so that the pipe load on the subgrade shall not exceed 3000 lbs/S.F.
Backing to be Class"A"Concrete, Item 905.

D	t	Wn	b
30	3.5	57	11.5
33	3.75	61	12
36	4	64	12.5
42	4.5	71	13.5
48	5	78	14.5
54	5.5	87	15.5
60	6	96	16.5
66	6.5	105	17.5
72	7	116	18.5
78	7	123	19.5
84	8.5	130	20.5
90	8	136	21.5
96	8.5	143	22.5
102	8.5	151	23.5
108	9	160	24.5

*Includes the volume of the Class "C" Concrete Block.

This drawing previously AA-S12

SEWER SYSTEM ENGINEERING MANAGER

ADMINISTRATOR

APPROVED

REVISED 12-3-97

TYPE II BEDDING
FOR RIGID SEWER PIPE
30"-108" DIAMETER
ITEM 901

CITY OF COLUMBUS, OHIO.
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF SEWERAGE & DRAINAGE

STANDARD
CONSTRUCTION DRAWING

DR. CAW
CK.

SHEET 1 OF 1

FILE NO. AA-S153