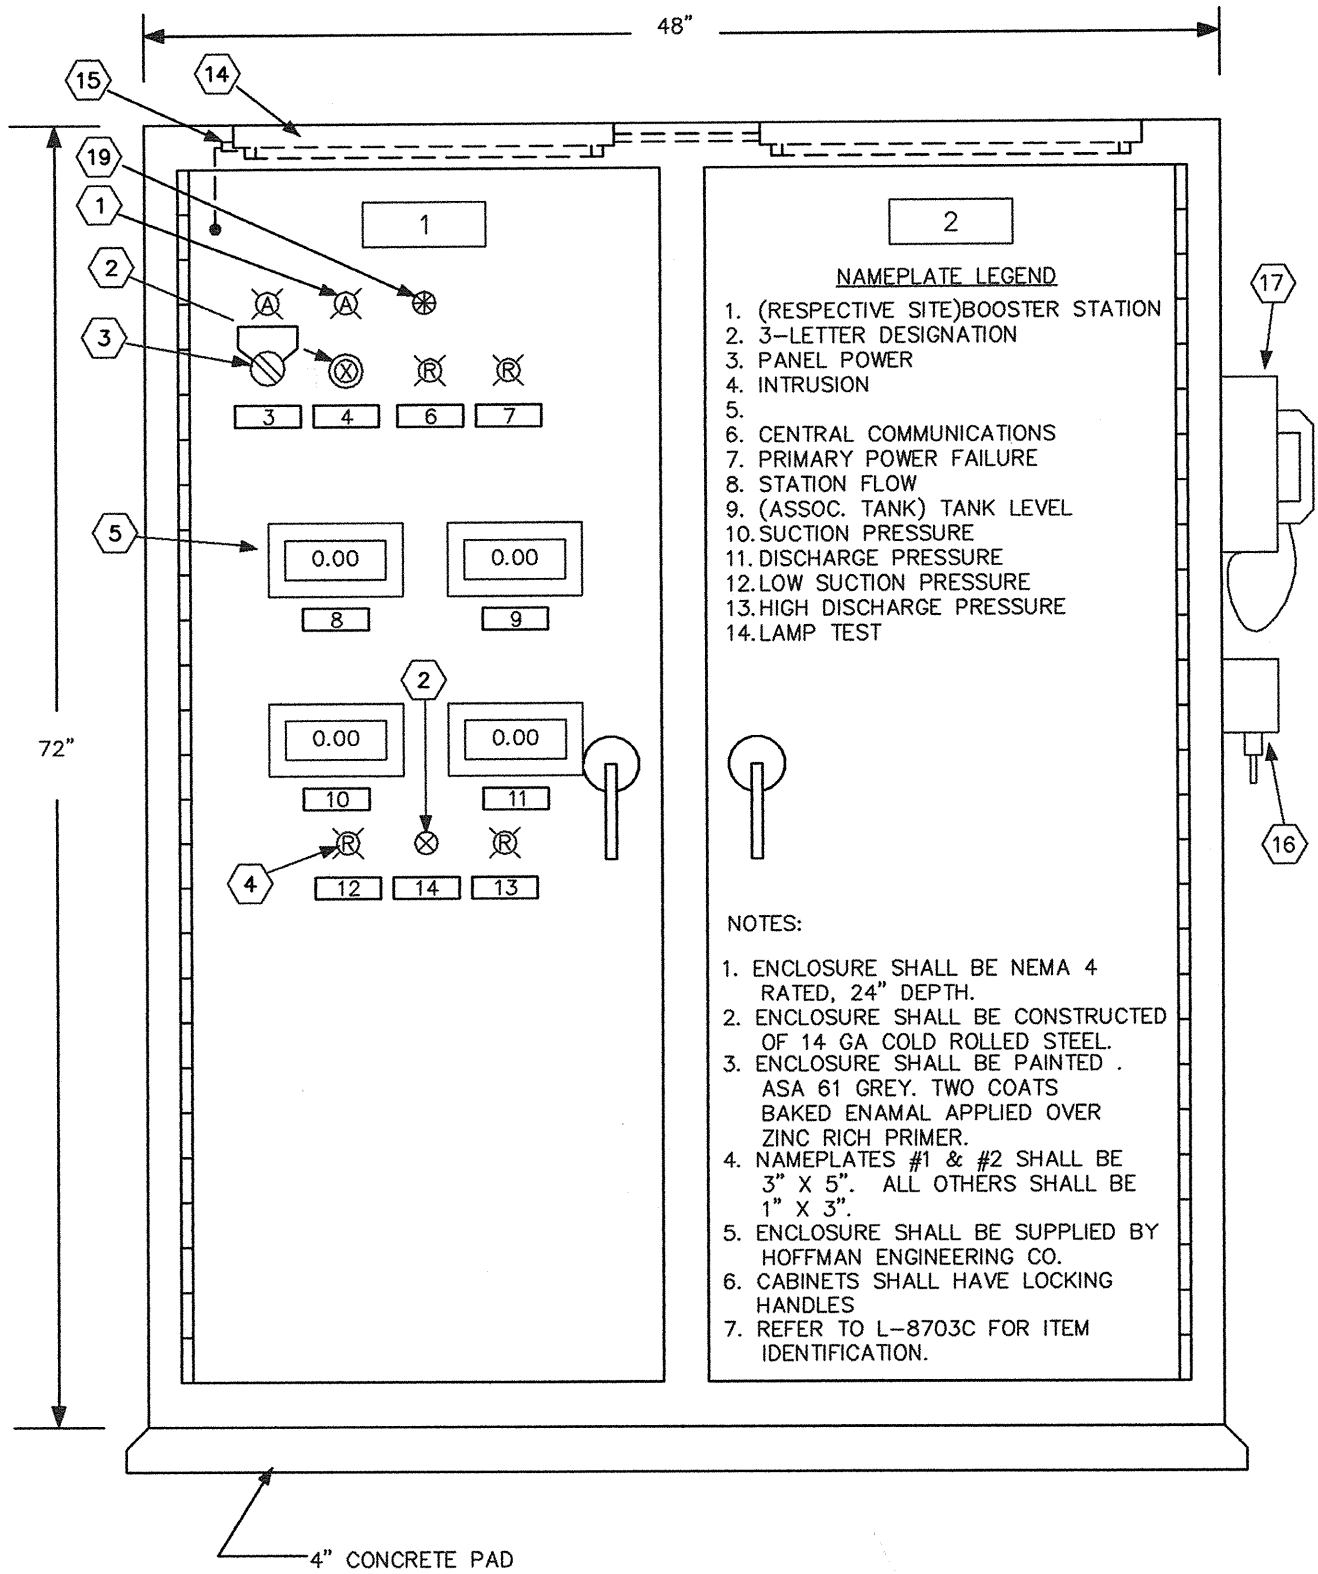

NAMEPLATE LEGEND

1. (RESPECTIVE SITE)BOOSTER STATION
2. 3-LETTER DESIGNATION
3. PANEL POWER
4. INTRUSION
5.
6. CENTRAL COMMUNICATIONS
7. PRIMARY POWER FAILURE
8. STATION FLOW
9. (ASSOC. TANK) TANK LEVEL
10. SUCTION PRESSURE
11. DISCHARGE PRESSURE
12. LOW SUCTION PRESSURE
13. HIGH DISCHARGE PRESSURE
14. LAMP TEST

NOTES:

1. ENCLOSURE SHALL BE NEMA 4 RATED, 24" DEPTH.
2. ENCLOSURE SHALL BE CONSTRUCTED OF 14 GA COLD ROLLED STEEL.
3. ENCLOSURE SHALL BE PAINTED . ASA 61 GREY. TWO COATS BAKED ENAMAL APPLIED OVER ZINC RICH PRIMER.
4. NAMEPLATES #1 & #2 SHALL BE 3" X 5". ALL OTHERS SHALL BE 1" X 3".
5. ENCLOSURE SHALL BE SUPPLIED BY HOFFMAN ENGINEERING CO.
6. CABINETS SHALL HAVE LOCKING HANDLES
7. REFER TO L-8703C FOR ITEM IDENTIFICATION.

REV. 2004

CITY OF COLUMBUS, OHIO DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER APPROVED R C Westerfield 1-21-05 ADMINISTRATOR DATE	STANDARD DETAIL BOOSTER STATION ENCLOSURE	L-8703A