L-9001A.DWG

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:
ENGINEER
DATE 4/1/01

STANDARD DETAIL

PRV SETTING

L-9001A

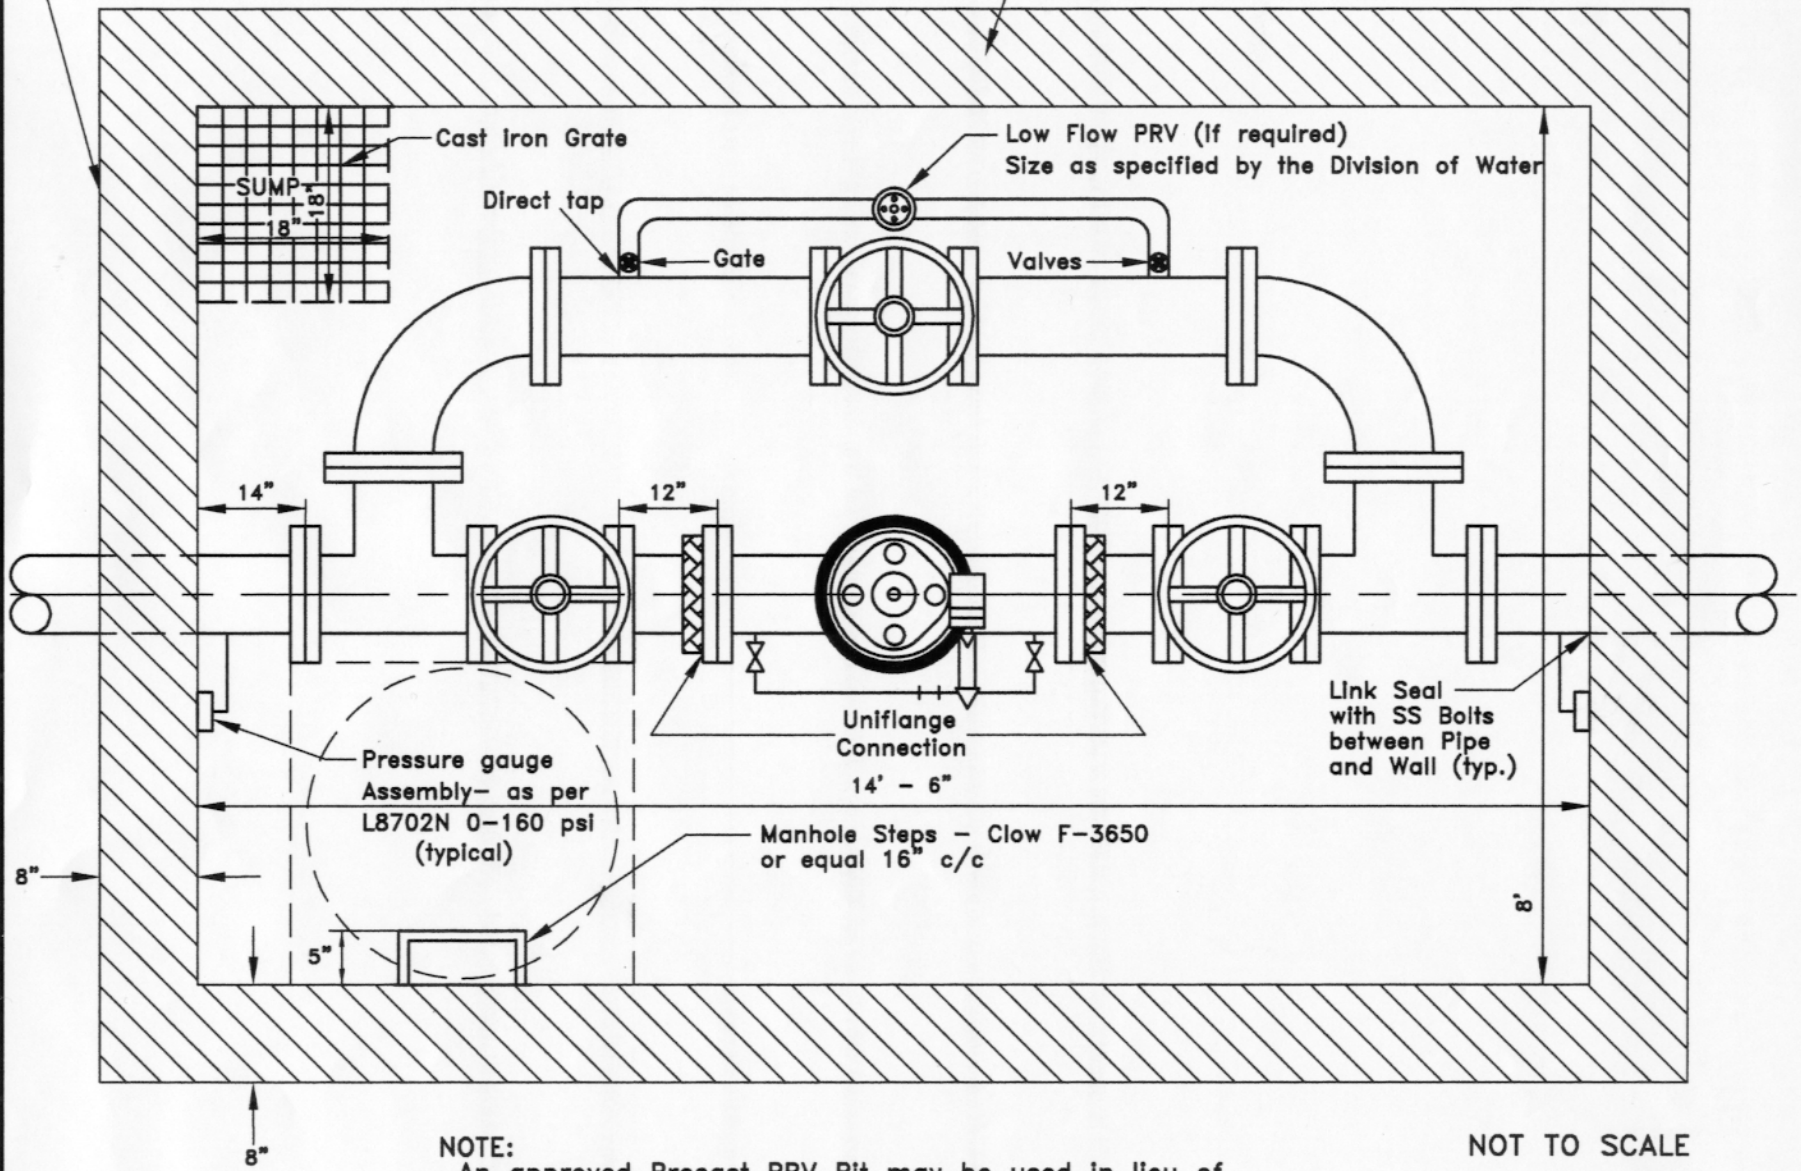

NOTE:
An approved Precast PRV Pit may be used in lieu of a constructed pit for outside settings.

NOT TO SCALE

The Operations Control Center shall be notified prior to the actual installation of the PRV to confirm flow direction and pressure settings.