RTU ANAOLG TERMINATIONS

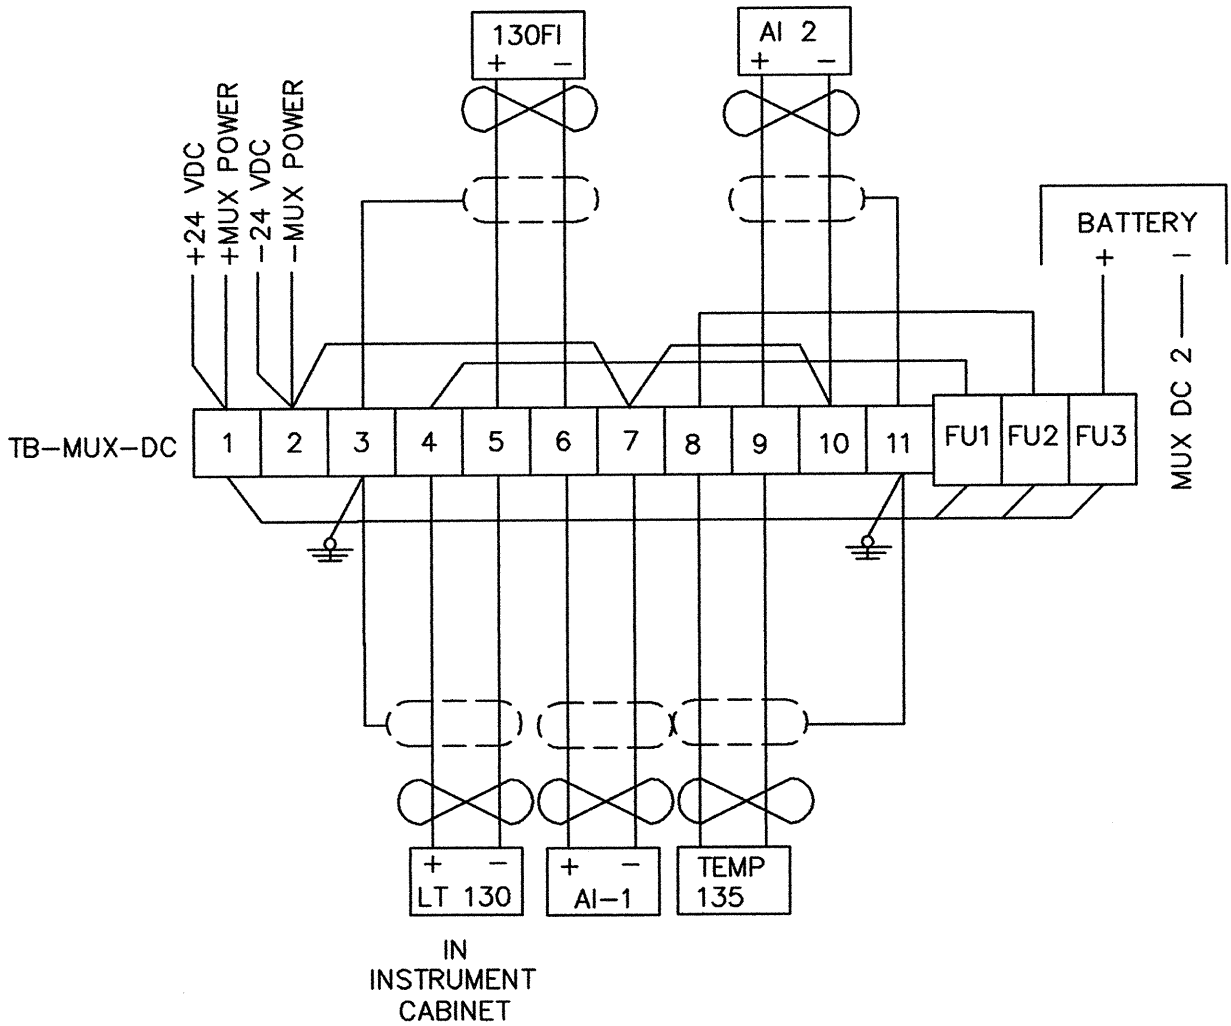

I/O TERMINATIONS IN MULTIPLEXER CABINETS

RTU ANALOG INPUT TERMINATOR

TANK LEVEL	+	AI−1−1	TB−MUX−DC−6
	−	AI−1−2	TB−MUX−DC−7
TANK TEMP	+	AI−2−1	TB−MUX−DC−9
	−	AI−2−2	TB−MUX−DC−10

REV. 2004

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED
RC Westerhold 1-21-05
ADMINISTRATOR DATE

STANDARD DETAIL
TANK MULTIPLEXER PANEL
POINT−TO−POINT WIRING

L−8701I